

SPF GT 40 A/C UNIT BASIC OPERATION

FIGURE 1

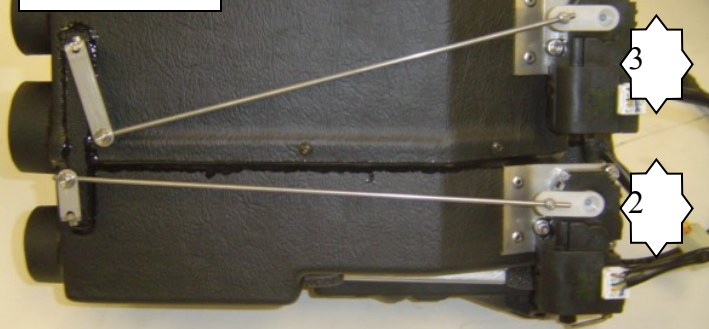


FIGURE 2

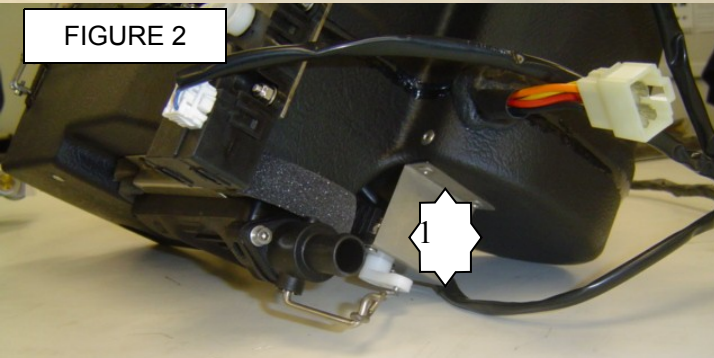


FIGURE 3


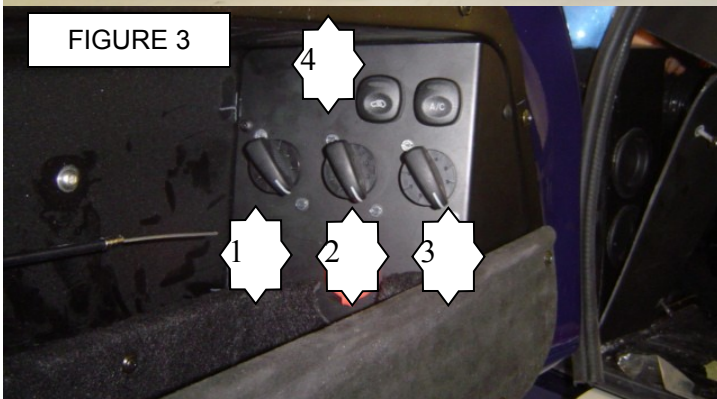


FIGURE 4

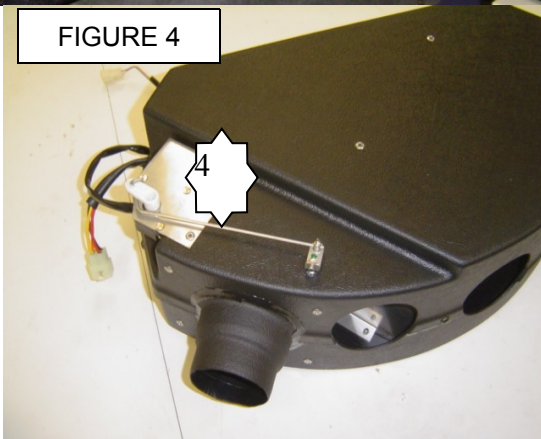

SWITCH ONE(1) SHOWN IN FIGURE 3 IS THE HEATER TEMPERATURE SELECTOR AND IT OPERATES SERVO MOTOR ONE(1) IN FIGURE 2.

SWITCH TWO(2) SHOWN IN FIGURE 3 IS THE FOOT/FACEVENT FLOW REGULATOR AND IT OPERATES SERVO MOTOR TWO(2) IN FIGURE 1.

SWITCH THREE(3) SHOWN IN FIGURE 3 IS THE FACE/DEMISTER FLOW REGULATOR AND IT OPERATES SERVO MOTOR THREE(3) IN FIGURE 1.

SWITCH FOUR(4) SHOWN IN FIGURE 3 IS THE RECIRCULATION FLOW SELECTOR AND IT OPERATES SERVO MOTOR FOUR(4) IN FIGURE 4.